

GENERAL DESCRIPTION

TPC-485 (labelled with PT100[®] and LM61) are 2 converters from temperature sensor to RS485 Modbus output. One converts values read from any PT100/PT1000 to RS485 Modbus through a dedicated 16 bit converter. The other converts values read from a Silicon Sensor encapsulated and distributed by us, to RS485 Modbus. Both converters can be used where thermopile pyranometers without a socket for the module's temperature sensors are used, so they are a suitable complement for those using a thermopile pyranometer. Both models have 2 input channels for temperature measurements.

TPC-485 labelled with LM 61		TPC-485 labelled with PT100	
Convertor from our Silicon Temp.Sensor to RS485		Converter from any PTC to RS485	
		Reference standard IEC 60751	
The converter is compatible with Smartlogger 3000, Sungrow Ermes, Higecco			
Measured Value	Sensor 1 -30 ÷ +85 °C toll. ± 3 °C Sensor 2 -30 ÷ +85 °C toll. ± 3 °C	Measured Value	Sensor 1 -40 ÷ +110 °C toll. ± 0.2 °C Sensor 2 -30 ÷ +110 °C toll. ± 0.2 °C
Temperature Sensor	Silicon Sensor TPC resolution	Temperature Sensor	Any PT100 or PT1000 at 2-3-4 wires resolution
Precision of the T. sensor	± 2.2°C	Precision of the T. sensor	Depending by the PTC. With TPC prec.± 0.15°C
Precision of converter	0.1° C		
Precision Overall	± 2.2°C	Precision Overall	± 0.2°C
Calibration	Each TPC labelled with LM61 is made by a T.I, Instrument sensor factory calibrated	Calibration	with 2 reference points using precision reference resistances.
Output	Serial: RS485, standard Modbus RTU protocol distance-covered (signal) : atleast 600 m		
Non-linearity	≤0.3%		
Supply voltage	8 – 30 V dc consumption <0,06A Protected against reverse polarity and overvoltage		
Consumption (@ 12V)	0.1 W		
Encapsulation	Resin conformal coating		
Casing	IP67 – Coated grey Aluminium		
Connector	INPUT: M 12 – 8 Pin FEMALE OUTPUT: M8 4 Pin MALE		
Dimensions	97x64x34 mm		
Operating temperature	-40 ÷ 125 °C toll. ± 0.2° C		
Box Working temperature	(-30 ÷ +85 °C)		
Operating humidity	0 ÷ 95% RH		
Weight	200 gr		

PRODUCTION BATCH DETAILS:

- Date:..... Operator:

- S/N:..... Modbus Node:

ELECTRICAL INSTALLATION

WIRINGS

From Converter to Datalogger

Connector Output	M8 Male
# pin	Description
1	RS485+/B, non inverting bus line RS485
2	Power supply +7,5 ÷ 28Vdc
3	RS485-/A, inverting bus line RS485
4	Common (0V)

Tab. 1



Fig. 3 Front male connector

figure 3 shows the male connector already mounted on our converter

From Temperature probe to Converter there is a M12 8 pins First 4 pin as are reserved for 1st temperature probe, the others for the 2nd temperature probe. A 3 way connector grant waterproof in case 2 temperature probes are connected.






Fig. 4 Back female connector

From Temperature Probe to Converter

Connector Input	M12 male 8 pins	
# pin	TPC-485 labelled with LM61	TPC-485 labelled with PT100
1	Sensor 1 – + V	Sensor 1 – Pin 1 (RED)
2	Sensor 1 –	Sensor 1 – Pin 1 (BLACK)
3	Sensor 1 – GND	Sensor 1 – Pin 2 (WHITE)
4	Sensor 1 – Signal	Sensor 1 – Pin 2 (GREEN)
5	Sensor 2 – + V	Sensor 2 – Pin 1 (RED)
6	Sensor 2 –	Sensor 2 – Pin 1 (BLACK)
7	Sensor 2 – GND	Sensor 2 – Pin 2 (WHITE)
8	Sensor 2 – Signal	Sensor 2 – Pin 2 (GREEN)


Tab.

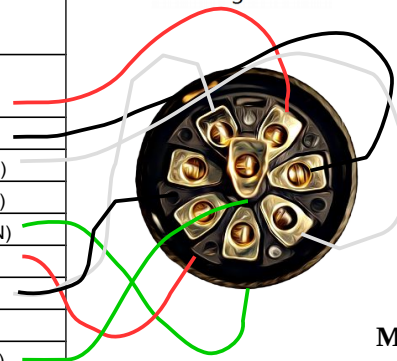

M12 8pin male connector

A 3 way connector grants waterproof in case 2 temperature probes are connected.

Connection: for durable wiring we recommend the use of lacquer after wires connections.

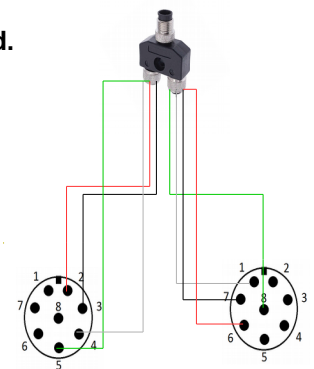

MALE CONNECTOR

MALE CONNECTOR

Data is accessible through registers read via Modbus. Below is the map of accessible logs in this release

Function Code	Description
0x03	READ HOLDING REGISTERS
0x04	READ INPUT REGISTERS
0x06	WRITE SINGLE REGISTER
0x10	WRITE MULTIPLE REGISTERS

Modbus is a Master-Slave protocol, widely used as an industry standard. Simple, efficient and reliable.





Please note that in the current implementation of TPC-485 labelled with PT100 or TPC-485 labelled with LM61 Pro function codes 0x03 and 0x04 are equivalent and address the same data area.

Data is accessible through Modbus's functions by 16 bits units called "registers". In the current implementation of TPC-485 labelled with LM61 are available in these registers:

TPC-485: register map

Register # _(HEXA)	Description	Access	NV save																		
0x0101	Probe 1 temperature x 10 [°C]	R																			
0x0103	Probe1 Status <table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th>Val. (DEC)</th> <th>TPC-485 labelled with PT100</th> <th>TPC-485 labelled with LM61</th> </tr> </thead> <tbody> <tr> <td>016</td> <td>When PT100/PT1000 => Probe 1 is Open</td> <td>0x5858 LM61 connected</td> </tr> <tr> <td>017</td> <td>When PT100/PT1000 => Probe 1 is Normal</td> <td></td> </tr> <tr> <td>031</td> <td>When PT100/PT1000 => Probe 1 is Short</td> <td></td> </tr> </tbody> </table>	Val. (DEC)	TPC-485 labelled with PT100	TPC-485 labelled with LM61	016	When PT100/PT1000 => Probe 1 is Open	0x5858 LM61 connected	017	When PT100/PT1000 => Probe 1 is Normal		031	When PT100/PT1000 => Probe 1 is Short									
Val. (DEC)	TPC-485 labelled with PT100	TPC-485 labelled with LM61																			
016	When PT100/PT1000 => Probe 1 is Open	0x5858 LM61 connected																			
017	When PT100/PT1000 => Probe 1 is Normal																				
031	When PT100/PT1000 => Probe 1 is Short																				
0x0105	Probe1 Type Setup-ed (DEC) <table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th>Val. (DEC)</th> <th>Meaning</th> </tr> </thead> <tbody> <tr> <td>0</td> <td>Not connected</td> </tr> <tr> <td>1</td> <td>LM61</td> </tr> <tr> <td>10102</td> <td>2 Pin – PT100</td> </tr> <tr> <td>10103</td> <td>3 Pin – PT100</td> </tr> <tr> <td>10104</td> <td>4 Pin – PT100</td> </tr> <tr> <td>11002</td> <td>2 Pin – PT1000</td> </tr> <tr> <td>11003</td> <td>3 Pin – PT1000</td> </tr> <tr> <td>11004</td> <td>4 Pin – PT1000</td> </tr> </tbody> </table>	Val. (DEC)	Meaning	0	Not connected	1	LM61	10102	2 Pin – PT100	10103	3 Pin – PT100	10104	4 Pin – PT100	11002	2 Pin – PT1000	11003	3 Pin – PT1000	11004	4 Pin – PT1000	R	
Val. (DEC)	Meaning																				
0	Not connected																				
1	LM61																				
10102	2 Pin – PT100																				
10103	3 Pin – PT100																				
10104	4 Pin – PT100																				
11002	2 Pin – PT1000																				
11003	3 Pin – PT1000																				
11004	4 Pin – PT1000																				
0x0102	Probe 2 temperature x 10 [°C]	R																			
0x0104	Probe2 Status <table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th>Val. (DEC)</th> <th>TPC-485 labelled with PT100</th> <th>TPC-485 labelled with LM61</th> </tr> </thead> <tbody> <tr> <td>032</td> <td>When PT100/PT1000 => Probe 2 is Open</td> <td>0x5858 LM61 connected</td> </tr> <tr> <td>033</td> <td>When PT100/PT1000 => Probe 2 is Normal</td> <td></td> </tr> <tr> <td>047</td> <td>When PT100/PT1000 => Probe 2 is Short</td> <td></td> </tr> </tbody> </table>	Val. (DEC)	TPC-485 labelled with PT100	TPC-485 labelled with LM61	032	When PT100/PT1000 => Probe 2 is Open	0x5858 LM61 connected	033	When PT100/PT1000 => Probe 2 is Normal		047	When PT100/PT1000 => Probe 2 is Short									
Val. (DEC)	TPC-485 labelled with PT100	TPC-485 labelled with LM61																			
032	When PT100/PT1000 => Probe 2 is Open	0x5858 LM61 connected																			
033	When PT100/PT1000 => Probe 2 is Normal																				
047	When PT100/PT1000 => Probe 2 is Short																				
0x0106	Probe2 Type Setup-ed(DEC) <table border="1" style="width: 100%; border-collapse: collapse;"> <tbody> <tr> <td>0</td> <td>Not connected</td> </tr> <tr> <td>1</td> <td>LM61</td> </tr> <tr> <td>20102</td> <td>2 Pin – PT100</td> </tr> <tr> <td>20103</td> <td>3 Pin – PT100</td> </tr> </tbody> </table>	0	Not connected	1	LM61	20102	2 Pin – PT100	20103	3 Pin – PT100	R											
0	Not connected																				
1	LM61																				
20102	2 Pin – PT100																				
20103	3 Pin – PT100																				

	20104	4 Pin – PT100		
	21002	2 Pin – PT1000		
	21003	3 Pin – PT1000		
	21004	4 Pin – PT1000		
0x8001	Serial number, least significant word		R	
0x8002	Serial number, most significant word		R	
0x8003	Firmware main version, hexadecimal		R	
0x8004	Firmware minor version, hexadecimal		R	
0x8005	Node address, range 1 ÷ 247, decimal, default 1		R/W	
0x8006	Bitrate, coded, range 0 ÷ 4, decimal, default 1 0 – 9600 bps 1 – 19200 bps 2 – 38400 bps 3 – 57600 bps 4 – 115200 bps		R/W	
0x8007	Serial configuration, coded, range 0 ÷ 3, decimal, default 0 0 – 8N1 (8 bit / no parity / 1 stop bit) 1 – 8E1 (8 bit / even parity / 1 Stop bit) 2 – 8O1 (8 bit / odd parity / 1 stop bit) 3 – 8N2 (8 bit / no parity / 2 stop bit)		R/W	
0x8008	Serial reply delay [ms], range 0 ÷ 100, decimal, default 1		R/W	

			
GoodWe EZLogger-Smx-485	Huawei SmartLogger 1000/2000/3000	SMA Data Manager M	Sungrow COM100

CALIBRATION

We recommend sending it to the manufacturer for calibration verification in the presence of anomalous readings.

CONTACT US

Further information on the device can be found at the site:
<https://soluzionesolare.com/products/>

For technical assistance contact:
support@soluzionesolare.it

Soluzione Solare Srl

Tel. +39.0444.530234- Fax +39.0444.1830563 – VI – Italy

PART LIST

- TM Sensor
- M8 4 pin female connector
- user manual

For more product information and best practice services scan the qr code below.



For the disposal of the products contact us

